1 Products affected

Product hierarchy no.				Part no.	SBU	Product Type	Customer part no.
SBU	PG	PUG	Type				
01	002	002	0000000502	See table below	Circuit Protection	FPG3 fuse holder	-

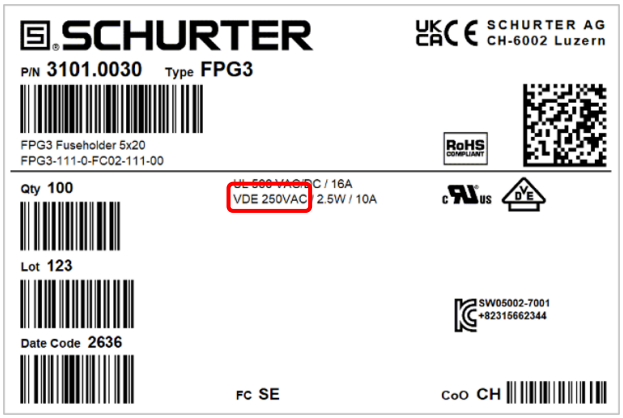
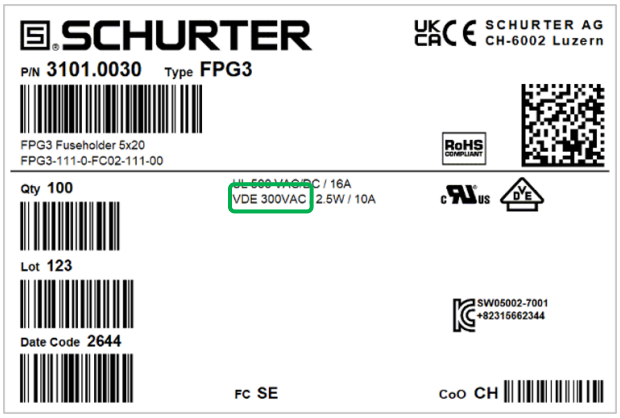
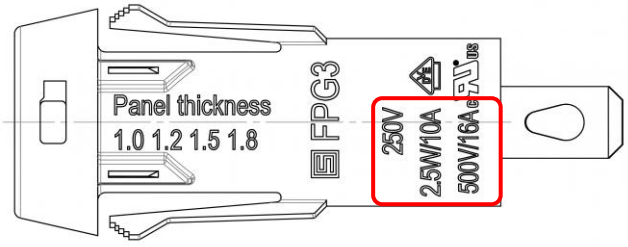
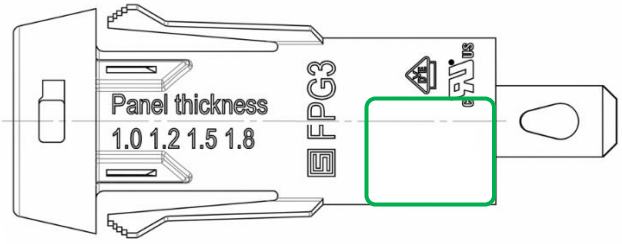
List of part numbers affected				
3-130-736	3-130-737	3-130-743	3-130-746	3-130-747
3101.0030	3101.0031	3101.0033	3101.0035	3101.0036
3101.0230	3101.0235	3101.0331	3101.0336	

2 Type of change

- Change of voltage rating
- Change of product marking
- Change of packaging label

3 Detailed description of change

The voltage rating changes from VDE 250VAC to 300VAC

Current Packaging Label	New Packaging Label
	
Current Product Marking	New Product Marking
	 The rating is not be mentioned on the product anymore

4 Reason of change

- VDE has approved the uprating to 300VAC for the FPG3 fuse holder

5 Release date

The change takes effect in week 44/2026 (Date Code 2644).
Parts on stock will be used upon depletion.

6 Impact of change and recommended action

☒	Form	No action required; inform incoming inspection about changes on product marking
☐	Fit	
☐	Function	
☐	Manufacturing	
☒	Label	No action required; inform incoming inspection about changes on packaging label
☐	Packaging	

7 Reference Documents

Kind of document	Document Title
Data sheet	FPG3